

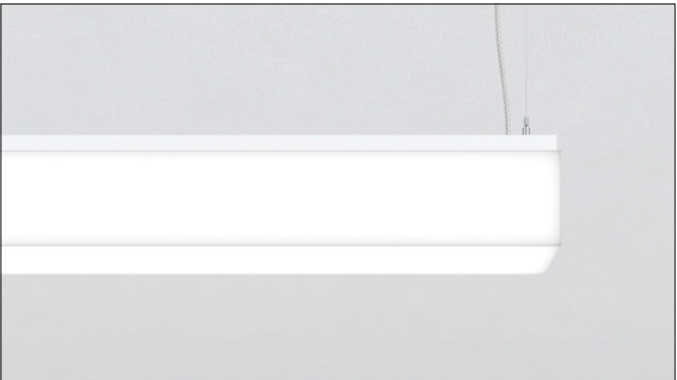
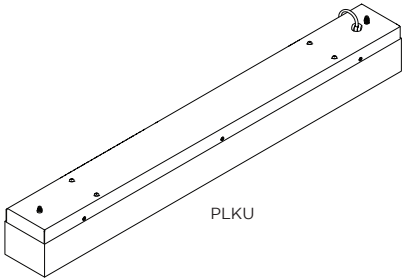
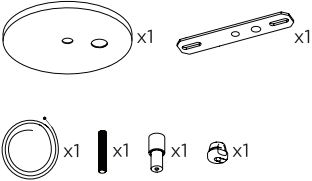





3G-PLKU4/PLKU6
4” LINEAR PENDANT KUBO
6” LINEAR PENDANT KUBO




THE IMAGES SHOWN ARE FOR ILLUSTRATION PURPOSES ONLY AND MAY NOT BE AN EXACT REPRESENTATION OF THE PRODUCT

INCLUDED COMPONENTS			
 PLKU	POWER FEED KIT	NON-POWER FEED KIT	
	  FOR GRID CEILING APPLICATION 	  FOR GRID CEILING APPLICATION 	


INSTRUCTION KEY	INFORMATION
 ADDITIONAL	INSTALLATION SHOULD ONLY BE PERFORMED BY A CERTIFIED ELECTRICIAN REFER TO LOCAL/NATIONAL CODES FOR PROPER INSTALLATION FAILURE TO FOLLOW INSTALLATION INSTRUCTION MAY VOID THE WARRANTY DO NOT TOUCH LEDS. LEDS MUST BE PROTECTED FROM MECHANICAL STRESS OR DEBRIS TURN OFF POWER DURING INSTALLATION OR SERVICING
 ATTENTION	
 POWER ON	
 POWER OFF	

SUSPENSION MOUNTING

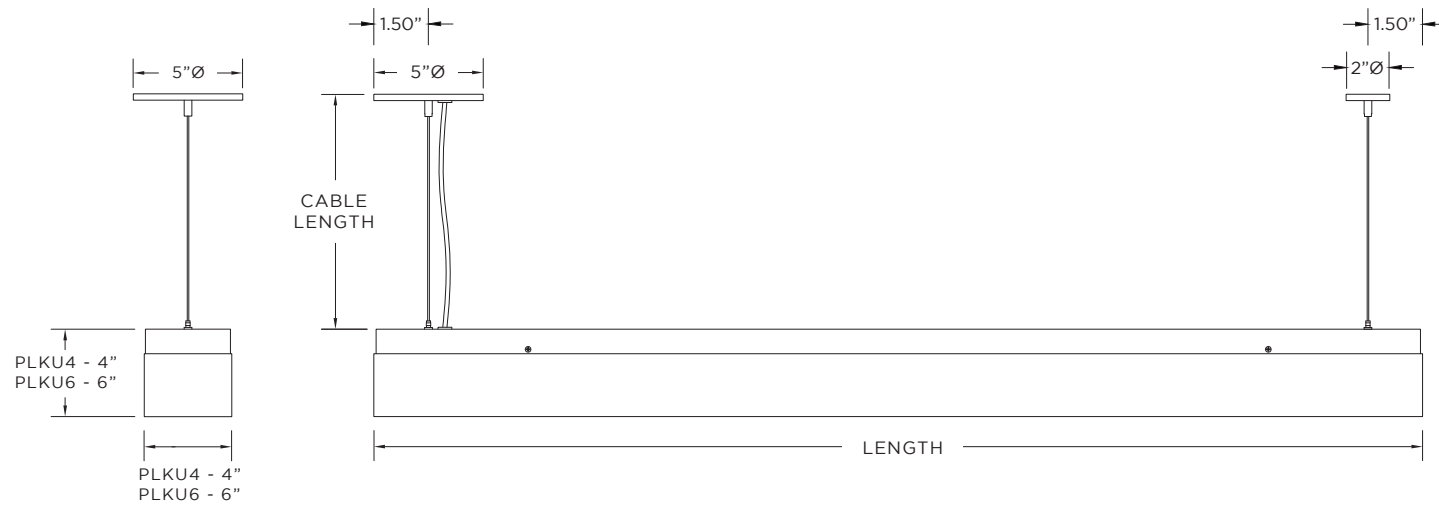

DRYWALL SUSPENSION


1

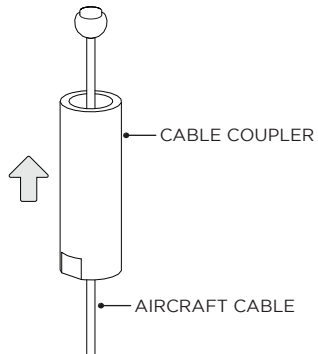


FEED AIRCRAFT CABLES THROUGH CABLE COUPLERS

2

POWER FEED SUSPENSION

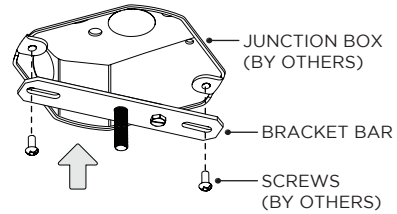

3

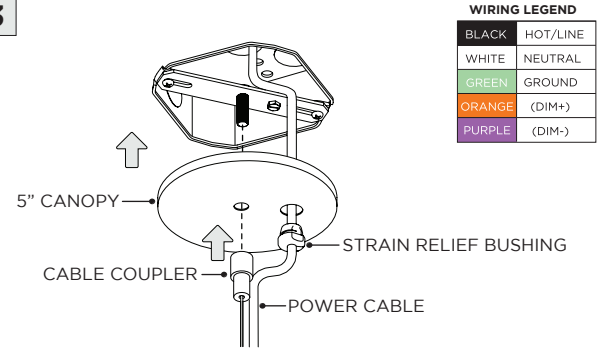

WIRING LEGEND


BLACK	HOT/LINE
WHITE	NEUTRAL
GREEN	GROUND
ORANGE	(DIM+)
PURPLE	(DIM-)




MAKE ELECTRICAL CONNECTIONS INSIDE JUNCTION BOX
SECURE 5" CANOPY TO CEILING

4


NON-POWER FEED SUSPENSION



5

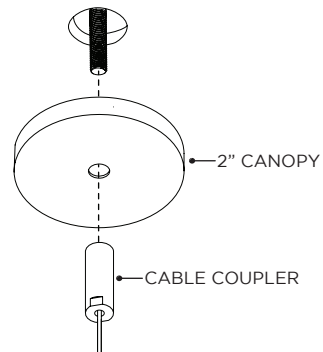


6

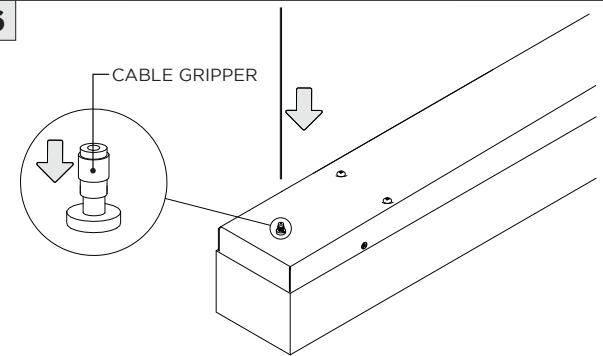

FEED AIRCRAFT CABLE THROUGH CABLE GRIPPER
LOOSEN AND PUSH DOWN ON CABLE GRIPPER TO ADJUST CABLE LENGTH
TIGHTEN CABLE GRIPPER TO LOCK POSITION


6A

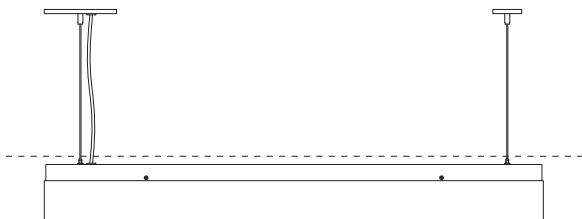

ENSURE FIXTURE IS LEVEL

GRID CEILING SUSPENSION

1

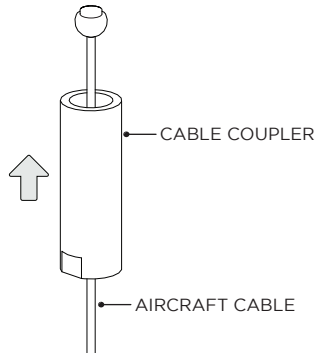


FEED AIRCRAFT CABLES THROUGH CABLE COUPLERS


2

POWER FEED SUSPENSION

IF NO JUNCTION BOX IS REQUIRED
REFER TO NON-POWER FEED SUSPENSION
STEPS FOR CANOPY MOUNTING

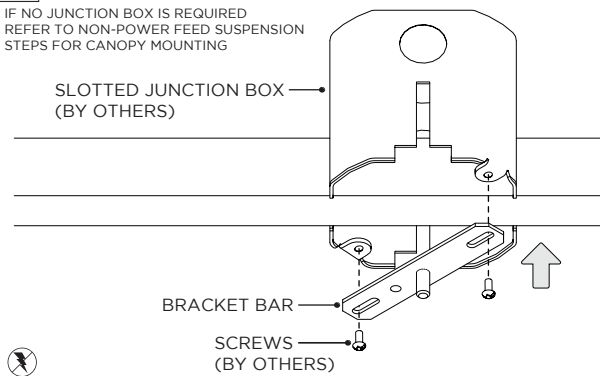


3

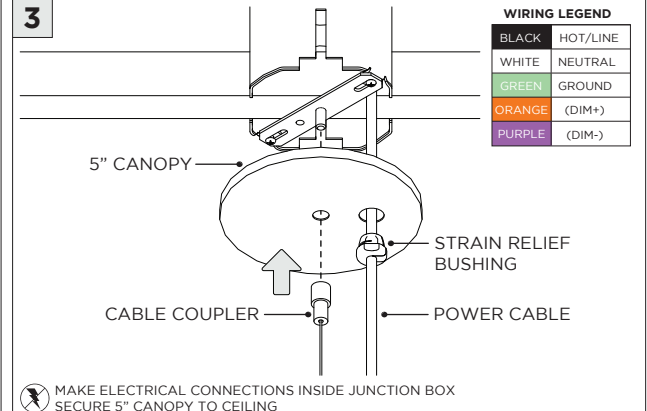


MAKE ELECTRICAL CONNECTIONS INSIDE JUNCTION BOX
SECURE 5" CANOPY TO CEILING

4

NON-POWER FEED SUSPENSION

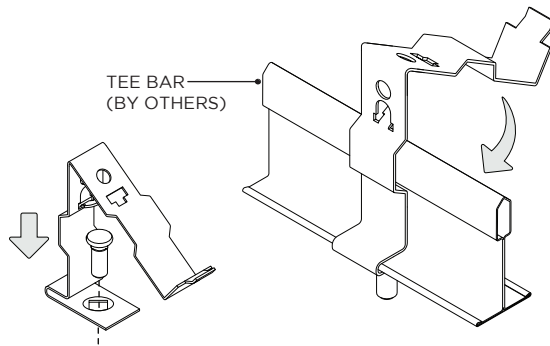


5

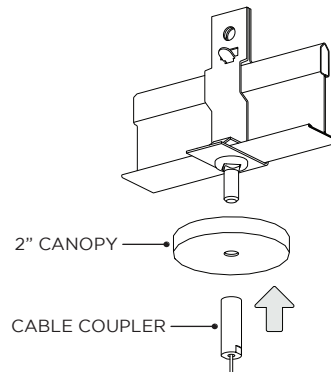


2" CANOPY USED FOR NON-POWER FEED SUSPENSION
5" CANOPY USED FOR POWER FEED SUSPENSION

6

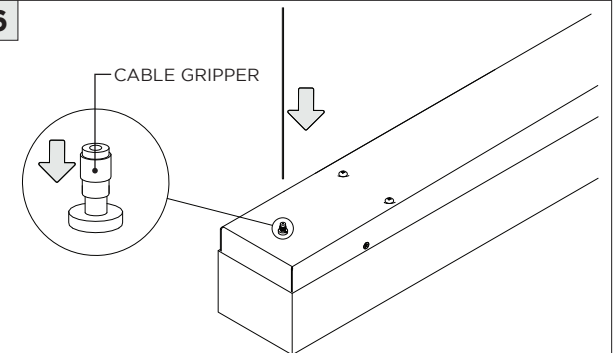





FEED AIRCRAFT CABLE THROUGH CABLE GRIPPER
LOOSEN AND PUSH DOWN ON CABLE GRIPPER TO ADJUST CABLE LENGTH
TIGHTEN CABLE GRIPPER TO LOCK POSITION

6A

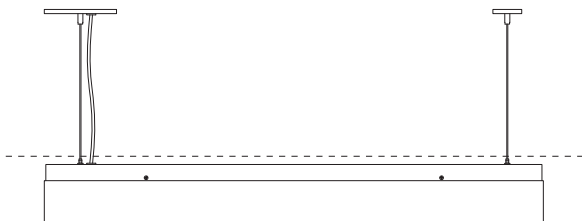


ENSURE FIXTURE IS LEVEL

DRIVER SERVICING

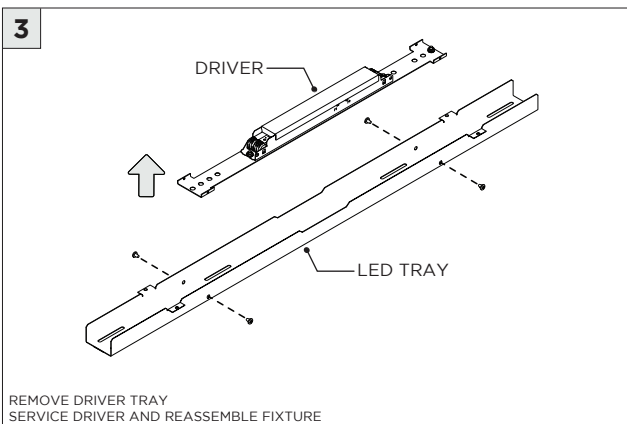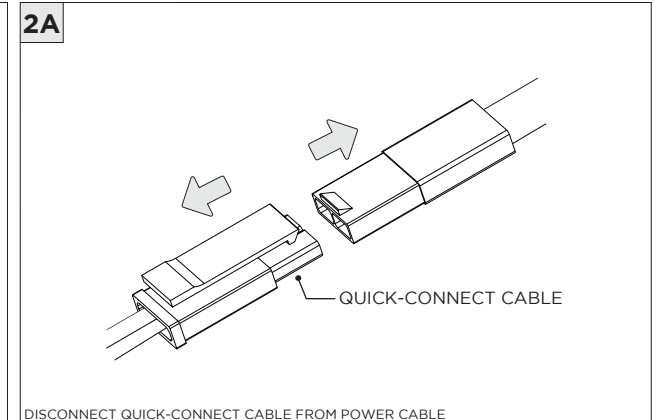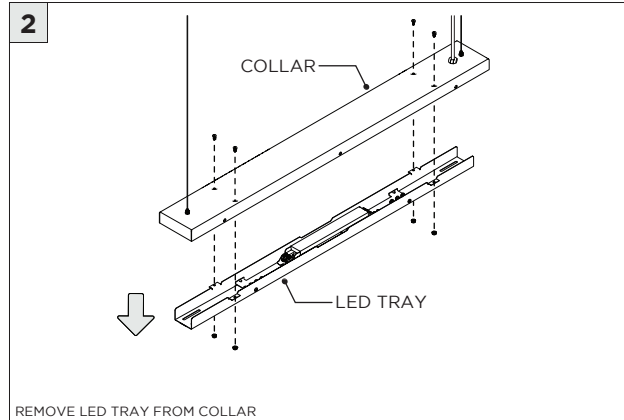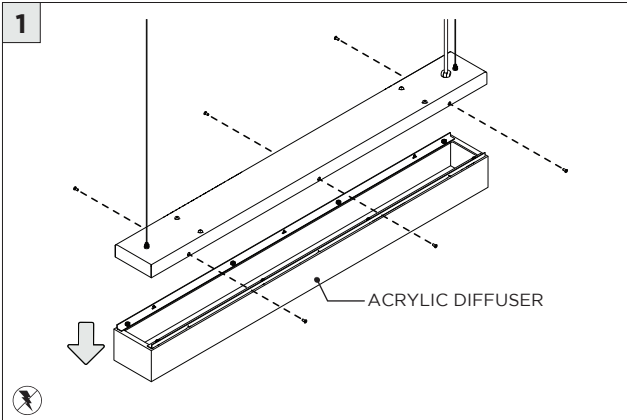


LED SERVICING

1

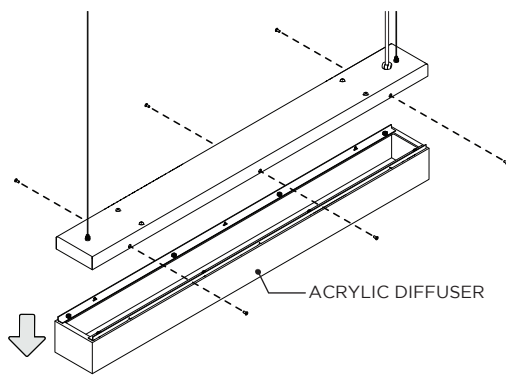


2

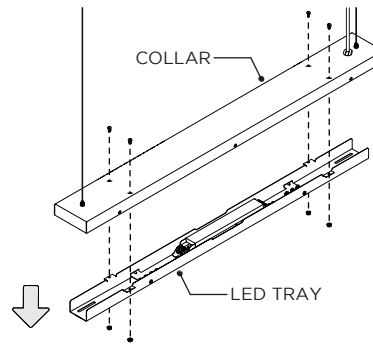


REMOVE LED TRAY FROM COLLAR

2A

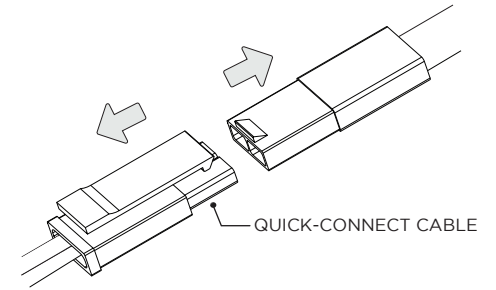

DISCONNECT QUICK-CONNECT CABLE FROM POWER CABLE

3

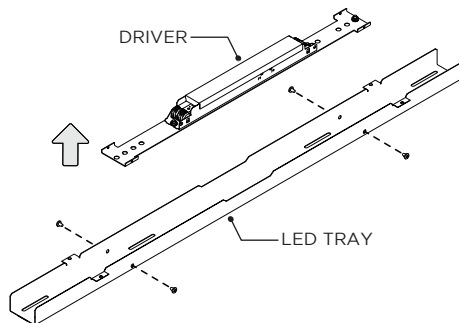

REMOVE DRIVER TRAY
REPLACE LED TRAY AND REASSEMBLE FIXTURE