









3G-PBA
ACOUSTIC PENDANT BAFFLE

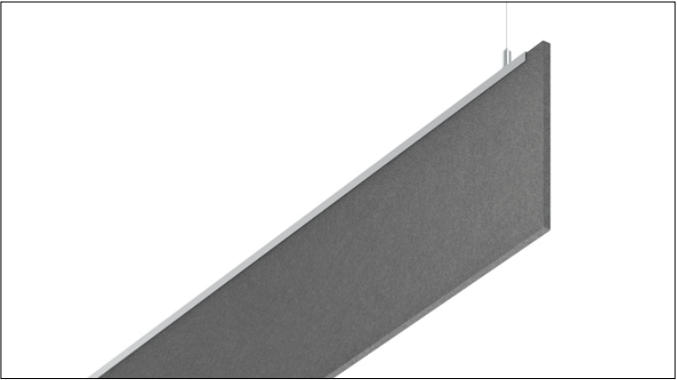


INCLUDED COMPONENTS	
Standalone Fixtures (2' to 8') 	
Non - Power feed kit  x1  x1  x1  x1  x1  x1  FOR GRID CEILING APPLICATION  x1  x1	

INSTRUCTION KEY	INFORMATION
 ADDITIONAL	INSTALLATION SHOULD ONLY BE PERFORMED BY A CERTIFIED ELECTRICIAN
 ATTENTION	REFER TO LOCAL/NATIONAL CODES FOR PROPER INSTALLATION
 POWER ON	FAILURE TO FOLLOW INSTALLATION INSTRUCTION MAY VOID THE WARRANTY
 POWER OFF	DO NOT TOUCH LEDS. LEDS MUST BE PROTECTED FROM MECHANICAL STRESS OR DEBRIS
	TURN OFF POWER DURING INSTALLATION OR SERVICING


SUSPENSION CABLE LOCATION

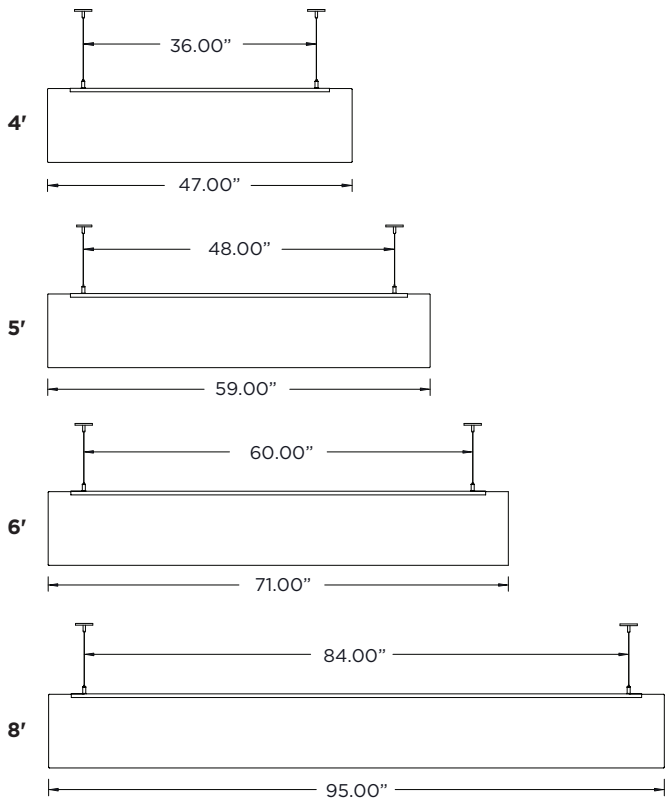


1 DRYWALL SUSPENSION - NON-POWER FEED

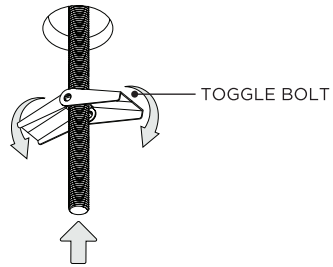


1A

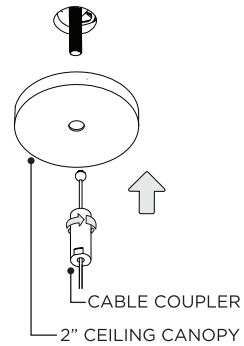


2

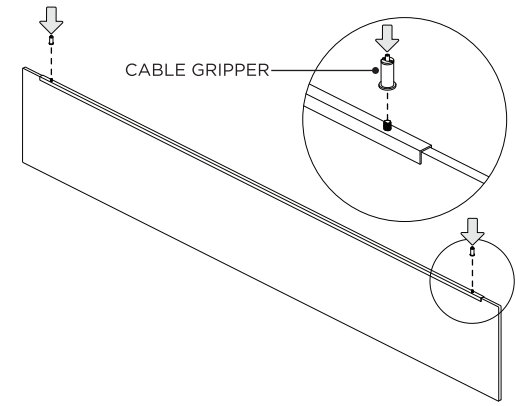


3

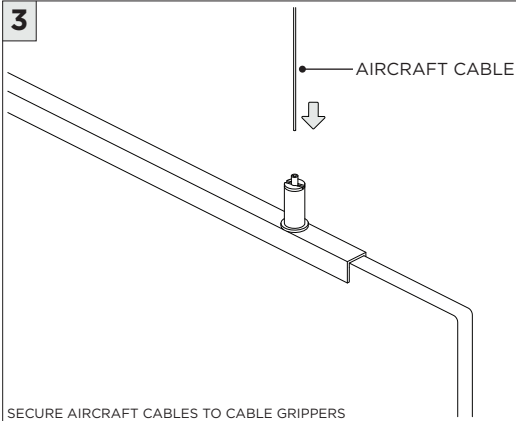


4

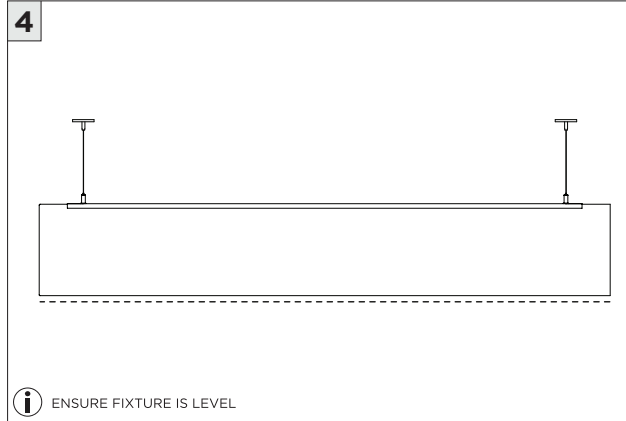


1 GRID CEILING SUSPENSION - NON-POWER FEED

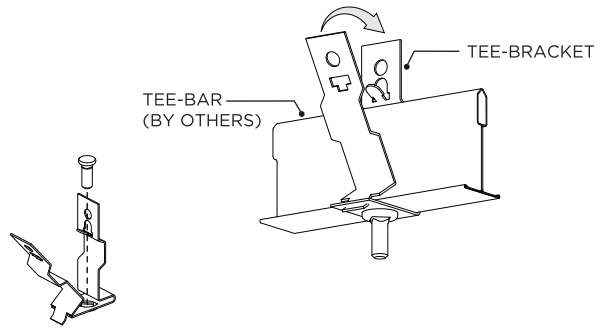


1A

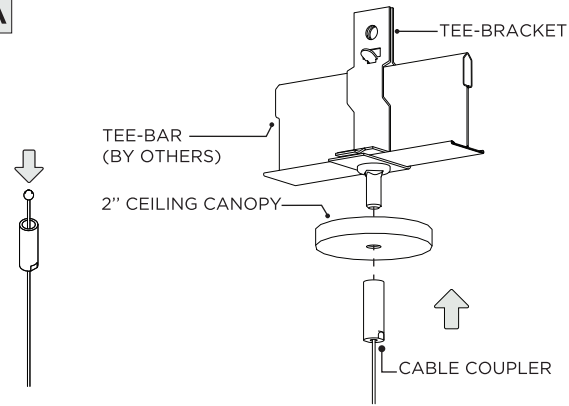

2

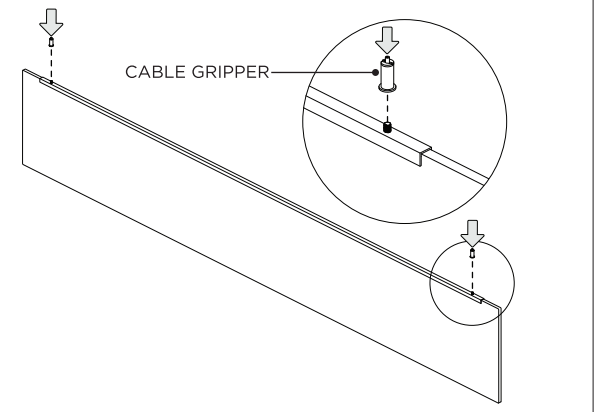

3

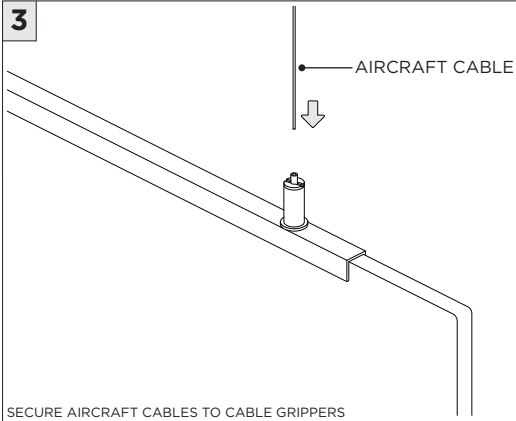

4

